

# MRL Passenger Elevator

## Hoistway Structure

Concrete  Brick & Concrete  Other

Unstandard  Standard


NOTE

Technical Requirement:


HW	HOISTWAY WIDTH	CW	CAR INSIDE WIDTH	Type	TKJW 630 / 15 -VF		
HD	HOISTWAY DEPTH	CD	CAR INSIDE DEPTH	F/P/D	12 / 12 /12	Door type	Center open
OP	DOOR OPENING WIDTH	CH	CAR HEIGHT	load	630	kg	speed 1.5 m/s
ROP	WALL OPENING WIDTH	MRW	MACHINE ROOM WIDTH	Machine	MCK200	Roping	2:1
OPH	DOOR OPENING HEIGHT	MRD	MACHINE ROOM DEPTH	T/sheave	∅ 4.00	D/sheave	∅
OH	OVERHEAD HEIGHT	MRH	MACHINE ROOM HEIGHT	car sheave	∅ 4.4.0	CW sheave	∅ 4.00
CAR DBG	DISTANCE BETWEEN CAR GUIDE RAILS			Shaft	HW	2000 mm x HD	2000mm
CWT DBG	DISTANCE BETWEEN COUNTERWEIGHT GUIDE RAILS			Cabin	CW	1100 mm x CD	14.00mm
				Door	OP	900 mm x OPH	2100mm



The hook

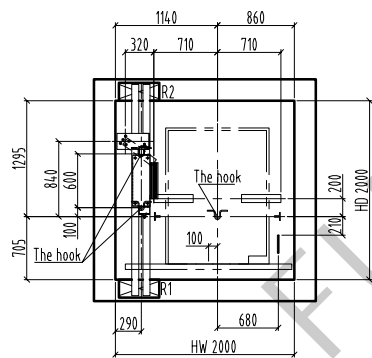


Overhead plan/1:60

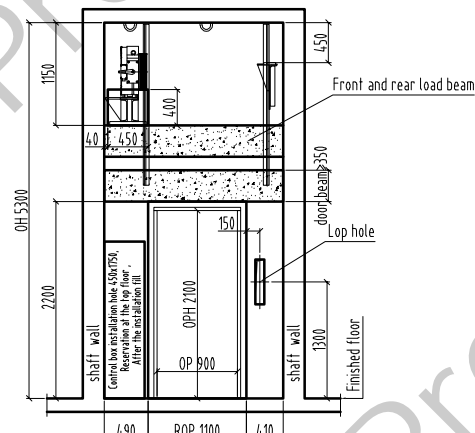

E/reserved hole/1: 60


Bottom box Lop: 100x500 (base station) 100x400 (remaining stations)  
No bottom box Lop hole: 950 hole

EL5-8

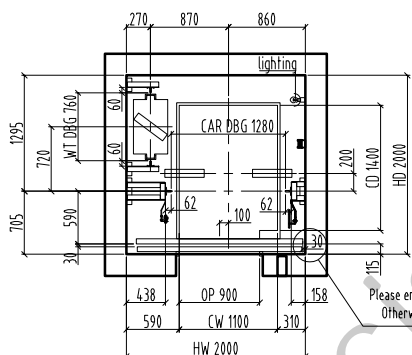


Hoistway plan/1:60

Please ensure the verticality of the hoistway. Otherwise you need to knock on the wall.

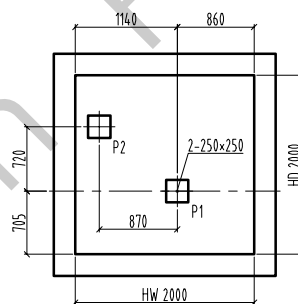

Pit plan/1: 60

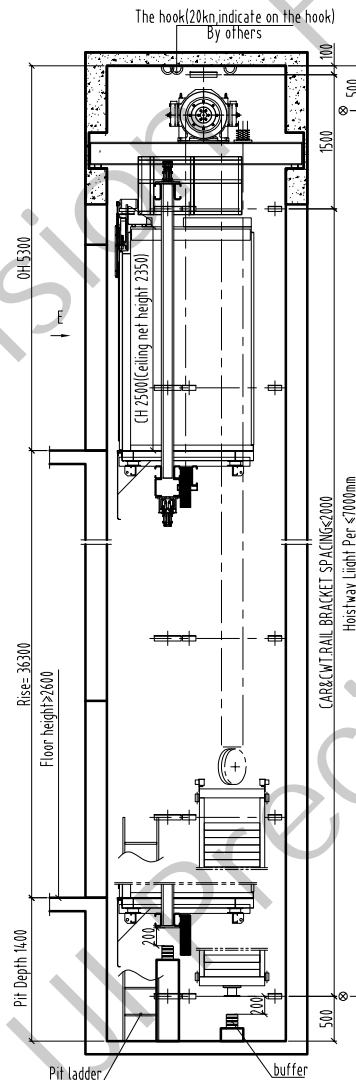

ELEVATION /1:60

### Support Force (N)

R1	R2	R3	R4	P1	P2	P3	P4
27900	27100			72800	56000		

### Technical Requirement

1. Power supply: machine room need equiped with power supply. Power supply box need be locked. Power supply should be 3P.5 wires, 380V 50Hz. Voltage tolerance  $\pm 7\%$ , input power more than 50% of motor power, also equiped with air switch same capacity with power supply, also allow the supplement leakage protector. When use VVVF, need use special leakage switch. Ground resistor should be < 4 $\Omega$ . It should use insulated conductor from floor to machine room. Keep separate for null wire and ground wire.

2. Shaft requirement, it should be only for lift, can not install non-related device (pipe, cable, etc), and should keep the person entrance. The shaft plan size mean the mm size measured by plumb line, tolerance  $\pm 50$ mm. Basically not allow the protruding beam and column. The proof pressure of shaft side should be  $\geq 24$ MPa. Recommend to use full concrete, can not use the reserved steel. In case use solid brick, it should use reserved steel or make the ring beam on the surface of reserved steel, height  $\geq 300$ mm. If use hollow brick, can choose C25 concrete fill into the wall, also make the ring beam on the surface of reserved steel, height  $\geq 300$ mm. If the shaft front wall is brick construction, it should make the concrete beam up side of door hole to fix the landing door bracket, height  $\geq 300$ mm. If have the requirement in the drawing, it should make the concrete in the entrance of hall door. If should equiped with lamp, brightness  $\geq 50$ Lx, install the lamp at 0.5m from the top and the bottom, in the middle, each lamp at  $\leq 1$ m. The buffer block should be made accompany with special person. before that need make the reserved  $\geq 4$  PCs joint bar  $\geq \phi 12$ mm, height  $\geq 500$ mm from the pit floor, and should water proof. Keep the space for person entrance. Pit ladder is by user. Should installed it in a suitable place. If there have basement downside of the pit should make the buffer block extend to the solid floor downside. If the floor distance between 2 floor  $> 1$ m, should set the safe door with the width 350mm, height 1800mm.

3. Machine room requirement (not for MRL). It had the passageway for the traction machine. The door opens outward, also can be locked. Installed the fan, keep the humidity  $< 85\%$ , temperature  $+5$ ~ $-0$ °C, surrounding the reserved hole should make the 50mm hole, keep the floor plan, also bear the load 700kg/m<sup>2</sup>. The motor beam should be supported in the concrete block, this concrete block should extend to the building beam or bearing wall. Bearing side should make the reserved same side steel. thickness 2mm, bearing side thickness should over the wall thickness 20mm, total thickness more than 75mm. Standard wall 200mm, recommend the bearing wall thickness  $\geq 200$ mm. The hook in the machine room should indicate the max. load. It should install the ladder and barrier in case have stair.

OH	5300
Rise	36300
26 F	
25 F	
24 F	
23 F	
22 F	
21 F	
20 F	
19 F	
18 F	
17 F	
16 F	
15 F	
14 F	
13 F	
12 F	
11 F	
10 F	
9 F	
8 F	
7 F	
6 F	
5 F	
4 F	
3 F	
2 F	
1 F	
G F	
B F	
Pit	1400
Floor	Height

Drawing	approver	
Drawing No.	FTKW 630 -02	
manufacturing no.		
Project name		

FUJI PRECISION